




# IEA PVPS Task 15 Subtask C BIPV Guidebook

**Costa Kapsis, Ph.D., M. ASCE, M. ASHRAE**

Department of Civil and Environmental Engineering,  
University of Waterloo, Canada

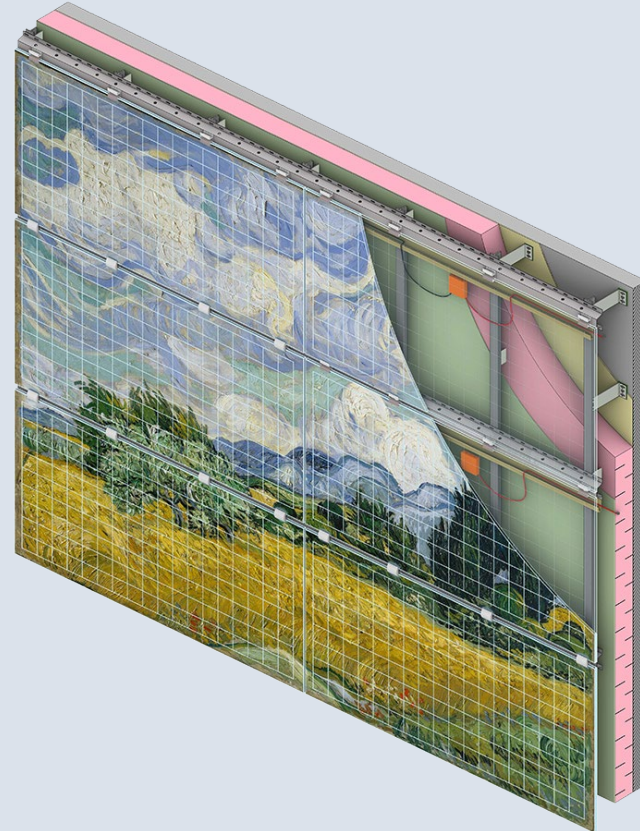



### Objectives

- Consolidate existing BIPV industry knowledge;
- Support the implementation of best BIPV practices (for new and retrofit buildings);
- Drive the decision-making process that could lead to an effective BIPV design & a robust BIPV installation.



### Deliverables

- Produce a BIPV guidebook with the complete pathway from BIPV design to installation, operation, maintenance & safety.



### Target Groups

- Building professionals: architects, engineers, consultants and PV installers




### TABLE OF CONTENTS

#### Foreword

- Chapter 1: Introduction
- Chapter 2: BIPV performance requirements
- Chapter 3: BIPV products
- Chapter 4: A decision-making process for BIPV design
- Chapter 5: Design of BIPV envelope & **case studies**
- Chapter 6: Operation & maintenance of BIPV systems

**Expected Publication Date: June 2024**

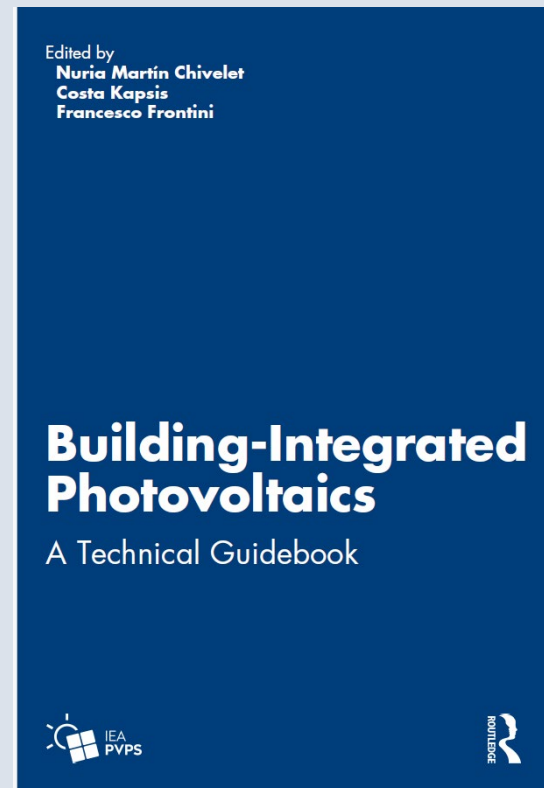



## Authors

Name	Affiliation	Country
<b>Nuria Martín Chivelet*</b>	CIEMAT	Spain
<b>Costa Kapsis*</b>	University of Waterloo	Canada
<b>Francesco Frontini*</b>	SUPSI	Switzerland
Pierluigi Bonomo	SUPSI	Switzerland
Tjerk Reijenga	BEAR-ID	China
Reidar Stølen	RISE	Norway
Helen Rose Wilson	Fraunhofer ISE	Germany
Alexander Astigarraga	Eurac Research	Italy
Simon Boddaert	CSTB	France
Maximilian Lugmair	FhS Salzburg	Austria
Gabriele Eder	OFI	Austria
Rebecca Yang	RMIT University	Australia
Ana Marcos Castro	CIEMAT	Spain
Astrid Schneider	Solar Architecture	Germany
Hisashi Ishi	LIXIL	Japan
Pabasara Wijeratne	RMIT University	Australia
Nilmini Weerasinghe	RMIT University	Australia

\*Co-editors



## BIPV APPLICATION CATEGORIES

- Rainscreens
- Curtain Walls
- Roofs
- Skylights
- Solar Shading
- Canopies & Shelters


## DESIGN ASPECTS ADDRESSED

- General Considerations
- Structural
- Hygrothermal Performance
- Fire Safety
- Electrical
- Architectural
- Sustainability & Circularity

# BIPV Rainscreens



- 1 Load bearing backing wall
- 2 Water/air barrier, adhered membrane or spray applied
- 3 Wall bracket, thermally-broken
- 4 Thermal insulation, mineral wool
- 5 Vertical substructure rail
- 6 Horizontal substructure girt
- 7 Cable management tray
- 8 Drainage/air flow cavity, 80 mm or more
- 9 BIPV module, frameless
- 10 Pressure plate
- 11 Pressure cap
- 12 BIPV module junction box and DC cables

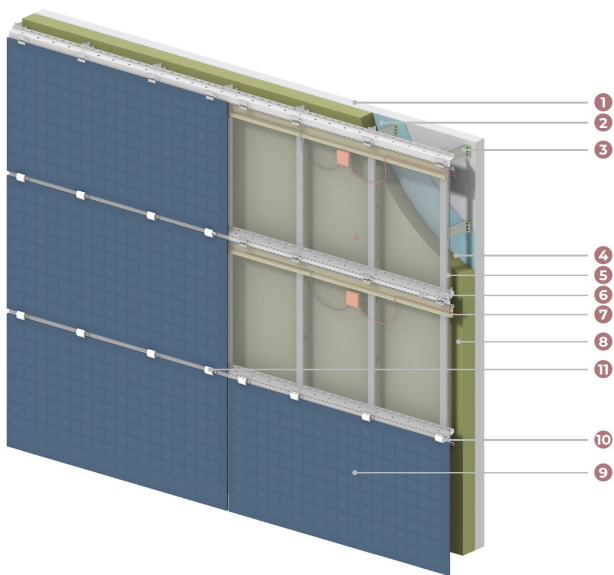

**General:** A BIPV rainscreen can be a cost-effective envelope solution for both new-build and retrofit projects. Its design considerations align with those of conventional rainscreen systems, supplemented by electrical and fire safety requirements [8].

**Structural Design:** The BIPV rainscreen must be engineered to endure and transfer both dynamic and static loads to the load bearing backing wall ①, in compliance with the local building codes. These primarily include the dead load resulting from the weight of the BIPV modules and sub-frame members, as well as dynamic wind loads. The connections between the brackets ③ and the vertical rails ⑤ are typically made with self-drilling screws or bolts and nuts, using fixed or sliding points. The sliding points are used to allow thermal expansion of the rails. The BIPV modules ⑫ can be mounted on the horizontal rails ⑥ using visible compression fittings ⑩ or concealed anchors adhered to the rear side of the BIPV modules. BIPV rainscreens tend to be drained and ventilated with open joints between modules to increase rear air flow while also allowing thermal expansion of the modules. When using a steel structure (galvanized or stainless) with framed BIPV modules, it is important to avoid electrical contact between metals and prevent galvanic corrosion of the anodized aluminium frame. This is not of concern with frameless BIPV modules.

**Hygrothermal Performance:** The BIPV cladding plays the role of the primary water barrier, deflecting most of the direct rain. A rainscreen cavity ⑧ allows any penetrating moisture to drain or evaporate and vent to the outside. The rainscreen cavity should be on average 100 mm or more to ensure adequate natural air flow for the BIPV modules and avoid overheating. Parapet and drain flashing should permit air flow while the installation of a permeable insect screen at the top and bottom course of rainscreen is recommended. An additional water/air barrier ② is applied (e.g., adhered membrane or spray applied) on the exterior face of the backing wall to eliminate any further water ingress and ensure an airtight construction. If required, electrical conduit penetrations should be used to bring the DC wiring from the rainscreen to the electrical room, using a flexible silicone grommet that offers an airtight and watertight seal, while also allowing the conduit to move without compromising the seal. The choice of thermal insulation ④ material and thickness depends on local building codes, fire safety regulations, and sustainability needs. Thermally broken brackets ③ should be used to reduce thermal bridging.

**Fire Safety:** The use of non-combustible insulation (e.g., mineral wool) is advised to reduce or prevent fire propagation through the rainscreen cavity. The use of fire barriers with an intumescent strip installed across the cavity can be an additional fire and smoke control practice.

**Electrical Considerations:** Effective cable management and labelling ensure BIPV rainscreen longevity. The use of cable trays ⑦, clips, and ties can help secure the wiring, prevent mechanical stress, and avoid abrasion from sharp corners and movement due to wind or other vibrations that could damage wiring or connectors. The connectors should have a minimum rating of IP 65 while the DC cables should be installed to avoid induction loops that can generate significant magnetic fields. When possible, the modules should be connected in a leapfrog fashion (vs daisy chain wiring). Façade shading should be accounted for during the string design. When applicable, low-profile pressure caps ⑪ are recommended to avoid casting shadows to the BIPV modules under high solar incidence angles.

**Architectural Considerations:** The use of coloured BIPV enables architects and designers to seamlessly integrate solar panels into the building's design, as the BIPV rainscreen can be customized to match or complement the building's colour scheme and architectural style, creating visually appealing and innovative structures that stand out while still being sustainable. When the BIPV rainscreen is susceptible to impacts or damage, protection can be ensured by taking precautions like installing the modules at least 0.8 m above the ground or above the wall skirting.

**Sustainability:** The BIPV rainscreen should be engineered to last for at least 35 years with future reuse in mind. Designing an adaptable sub-frame that accommodates different types of modules, enables the building envelope to adapt to changing technologies or aesthetic preferences. The system design should also consider ease of maintenance. Components that require periodic maintenance or replacement should be easily accessible without disrupting building operations.



## Manitou a bi Bii daziigae



PROJECT DESCRIPTION	
LOCATION	Winnipeg, Manitoba (49° 53'4" N)
USE	Academic
PV PRODUCER	SolarLab
ARCHITECT	Diamond Schmitt Architects and Number TEN Architectural Group
ENGINEER	SolarLab, SMS Engineering, Crosier Kilgour
INSTALLER	Flynn

PROJECT CHARACTERISTICS	
ANNUAL HORIZONTAL SOLAR IRRADIATION	1.37 MWh/m <sup>2</sup>
KÖPPEN CLIMATE CLASSIFICATION	Humid continental - Dfb
BIPV APPLICATION	Rainscreen
TYPE OF CONSTRUCTION	New
PV TECHNOLOGY	Opaque coloured mono-Si (BIPV), Bifacial mono-Si (rooftop)
BIPV ARRAY NOMINAL POWER	94 kW (BIPV), 54 kW (rooftop)
ANNUAL ELECTRICITY GENERATION PER BIPV MODULE AREA	112 kW/m <sup>2</sup>
ANNUAL ELECTRICITY GENERATION	80 MWh (BIPV) + 89 MWh (rooftop)



## Fanshawe College Innovation Village




PROJECT DESCRIPTION		PROJECT CHARACTERISTICS	
LOCATION	London, Ontario (42° 59' 1" N)	ANNUAL HORIZONTAL SOLAR IRRADIATION	1.5 MWh/m <sup>2</sup>
USE	Research Facility	KÖPPEN CLIMATE CLASSIFICATION	Humid continental- Dfb
PV PRODUCER	SolarLab	BIPV APPLICATION	Rainscreen
ARCHITECT	Diamond Schmitt Architects	TYPE OF CONSTRUCTION	New
ENGINEER	SolarLab, German Solar & Smith +Andersen	PV TECHNOLOGY	Opaque coloured mono-Si
INSTALLER	German Solar	BIPV ARRAY NOMINAL POWER	174.9 kW
		ANNUAL ELECTRICITY GENERATION PER BIPV MODULE AREA	263 kWh/m <sup>2</sup> (for active cell area only)
		ANNUAL ELECTRICITY GENERATION	123 MWh (façade only)





## NCC Headquarters

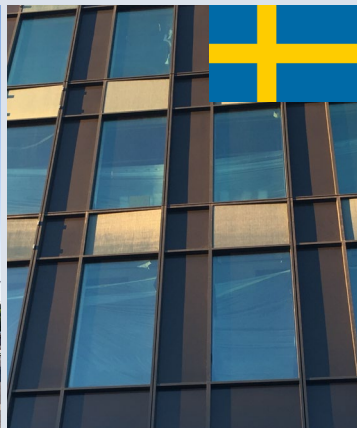

PROJECT DESCRIPTION		PROJECT CHARACTERISTICS	
LOCATION	Solna, Sweden (59° 22' 0" N)	ANNUAL HORIZONTAL SOLAR IRRADIATION	0.9 MWh/m <sup>2</sup>
USE	Office	KÖPPEN CLIMATE CLASSIFICATION	Humid temperate - Cfb
PV PRODUCER	NCC	BIPV APPLICATION	Curtain wall
ARCHITECT	Genit Vision by ISSOL	TYPE OF CONSTRUCTION	New
ENGINEER	White Arkitekter	PV TECHNOLOGY	Opaque coloured mono-Si
INSTALLER	NCC	BIPV ARRAY NOMINAL POWER	36.0 kW
		ANNUAL ELECTRICITY GENERATION PER BIPV MODULE AREA	60 kWh/m <sup>2</sup>
		ANNUAL ELECTRICITY GENERATION	22.0 MWh



## Palazzo Lombardia



PROJECT DESCRIPTION		PROJECT CHARACTERISTICS	
LOCATION	Milan, Italy (45° 29' 12" N)	ANNUAL HORIZONTAL SOLAR IRRADIATION	1.1 MWh/m <sup>2</sup>
USE	Government & Retail	KÖPPEN CLIMATE CLASSIFICATION	Humid temperate - Cfb
PV PRODUCER	EnergyGlass	BIPV APPLICATION	Curtain Wall
ARCHITECT	Sistema Duemila Architettura e Ingegneria	TYPE OF CONSTRUCTION	New
ENGINEER	PEI Cobb Freed & Partners, Caputo Partnership Consortium	PV TECHNOLOGY	Semi-transparent mono-Si
INSTALLER	ISA S.p.A.	BIPV ARRAY NOMINAL POWER	170.4 kW
		ANNUAL ELECTRICITY GENERATION PER BIPV MODULE AREA	73.5 kWh/m <sup>2</sup>
		ANNUAL ELECTRICITY GENERATION	104.4 MWh



## Glasberga Residential District



PROJECT DESCRIPTION		PROJECT CHARACTERISTICS	
LOCATION	Södertälje, Sweden (59° 11' 44" N)	ANNUAL HORIZONTAL SOLAR IRRADIATION	900 kWh/m <sup>2</sup>
USE	Residential	KÖPPEN CLIMATE CLASSIFICATION	Humid continental - Dfb
PV PRODUCER	Advanced Solar Power	BIPV APPLICATION	Roof
ARCHITECT	The Paradoumo Group	TYPE OF CONSTRUCTION	New
ENGINEER	Soltech Energy Sweden	PV TECHNOLOGY	CdTe solar shingles
INSTALLER	Soltech Energy Sweden	BIPV ARRAY NOMINAL POWER	75.8 kW
		ANNUAL ELECTRICITY GENERATION PER BIPV MODULE AREA	73.5 kWh/m <sup>2</sup>
		ANNUAL ELECTRICITY GENERATION	104.4 MWh





## Andreas Bjorns Gade 1



PROJECT DESCRIPTION		PROJECT CHARACTERISTICS	
LOCATION	Copenhagen, Denmark (55° 40' 31" N)	ANNUAL HORIZONTAL SOLAR IRRADIATION	1 MWh/m <sup>2</sup>
USE	Residential, Multi-Family	KÖPPEN CLIMATE CLASSIFICATION	Marine West Coast - Csb
PV PRODUCER	Owners Association	BIPV APPLICATION	Roof
ARCHITECT	Luxor (mounting system by Renusol)	TYPE OF CONSTRUCTION	Retrofit
ENGINEER	Krydsrum Arkitekter	PV TECHNOLOGY	Opaque mono-Si
INSTALLER	Ekolab	BIPV ARRAY NOMINAL POWER	20.3 kW
		ANNUAL ELECTRICITY GENERATION PER BIPV MODULE AREA	121.4 kWh/m <sup>2</sup>
		ANNUAL ELECTRICITY GENERATION	17 MWh



## Stazione AV Tornio Porta Susa

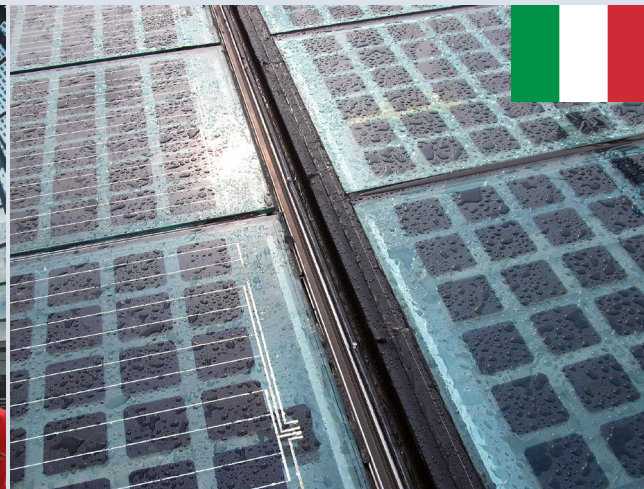
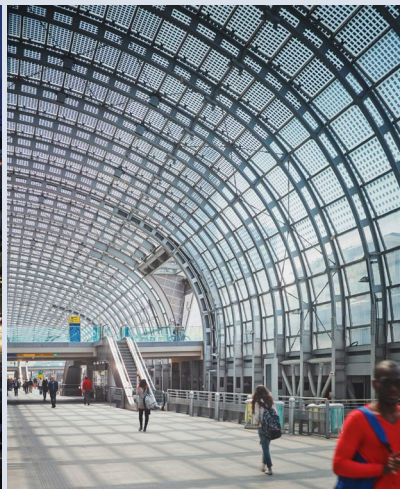


PROJECT DESCRIPTION	
LOCATION	Turin, Italy (45° 4' 22" N)
USE	Train station
PV PRODUCER	EnergyGlass, GruppoSTG
ARCHITECT	AREP, Silvio d'Ascia Architecture, Agostino Magnaghi
ENGINEER	AREP
INSTALLER	GruppoSTG

PROJECT CHARACTERISTICS		
ANNUAL HORIZONTAL SOLAR IRRADIATION		1.1 MWh/m <sup>2</sup>
KÖPPEN CLIMATE CLASSIFICATION		Humid subtropical - Cfa
BIPV APPLICATION		Skylight
TYPE OF CONSTRUCTION		New
PV TECHNOLOGY		Semi-transparent mono-Si
BIPV ARRAY NOMINAL POWER		765 kW
ANNUAL ELECTRICITY GENERATION PER BIPV MODULE AREA		75 kWh/m <sup>2</sup>
ANNUAL ELECTRICITY GENERATION		680 MWh



## Edmonton Convention Centre

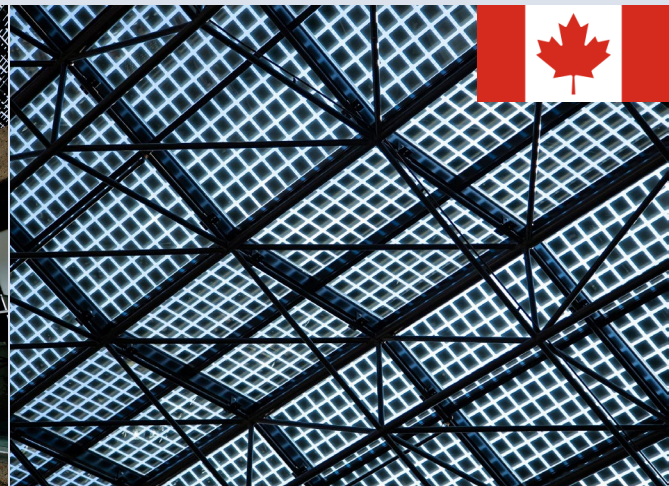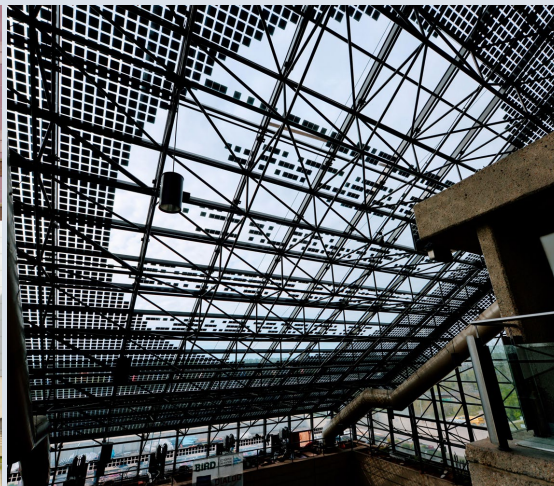


PROJECT DESCRIPTION	
LOCATION	Edmonton, Canada (53° 32' 31" N)
USE	Institutional
PV PRODUCER	Onyx Solar
ARCHITECT	DIALOG
ENGINEER	Howell-Mayhew Engineering
INSTALLER	Kuby Energy

PROJECT CHARACTERISTICS		
ANNUAL HORIZONTAL SOLAR IRRADIATION		1.3 MWh/m <sup>2</sup>
KÖPPEN CLIMATE CLASSIFICATION		Humid continental- Dfb
BIPV APPLICATION		Skylight
TYPE OF CONSTRUCTION		Retrofit
PV TECHNOLOGY		Semi-transparent amorphous Si
BIPV ARRAY NOMINAL POWER		169 kW
ANNUAL ELECTRICITY GENERATION PER BIPV MODULE AREA		128 kWh/m <sup>2</sup>
ANNUAL ELECTRICITY GENERATION		200 MWh



## Gothenburg Garage

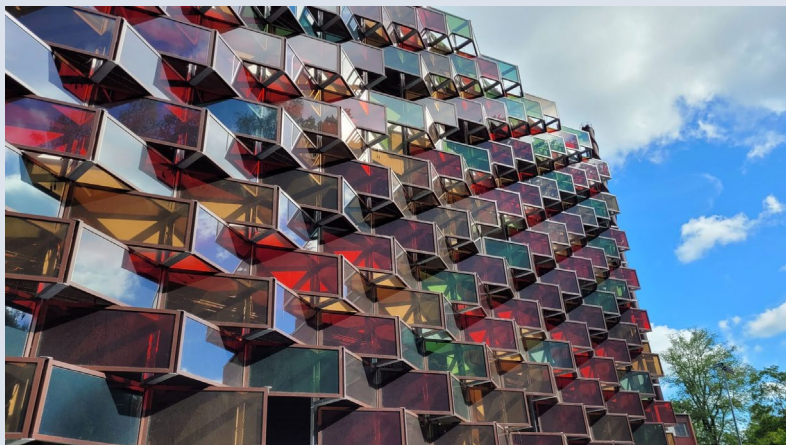

PROJECT DESCRIPTION		PROJECT CHARACTERISTICS	
LOCATION	Gothenburg, Sweden (57° 39' 41" N)	ANNUAL HORIZONTAL SOLAR IRRADIATION	790 kWh/m <sup>2</sup>
USE	Garage	KÖPPEN CLIMATE CLASSIFICATION	Humid temperate - Cfb
PV PRODUCER	Advanced Solar Power	BIPV APPLICATION	Solar shading
ARCHITECT	Liljewall arkitekter	TYPE OF CONSTRUCTION	New
ENGINEER	Fasadsystem (Soltech Energy Sweden subsidiary)	PV TECHNOLOGY	Semi-transparent coloured CdTe
INSTALLER	Fasadsystem	BIPV ARRAY NOMINAL POWER	60 kW
		ANNUAL ELECTRICITY GENERATION PER BIPV MODULE AREA	21 kWh/m <sup>2</sup>
		ANNUAL ELECTRICITY GENERATION	16.9 MWh



## Franklin University



PROJECT DESCRIPTION		PROJECT CHARACTERISTICS	
LOCATION	Sorengo, Switzerland (45° 59' 52" N)	ANNUAL HORIZONTAL SOLAR IRRADIATION	1.3 MWh/m <sup>2</sup>
USE	Residence	KÖPPEN CLIMATE CLASSIFICATION	Continental subarctic - Dfc
PV PRODUCER	SUNAGE	BIPV APPLICATION	Solar shading
ARCHITECT	Flaviano Capriotti Architetti	TYPE OF CONSTRUCTION	New
ENGINEER	Aziende Industriali di Lugano (AIL)	PV TECHNOLOGY	Coloured opaque multi-Si
INSTALLER	Kummler + Matter, Poretti Gaggini Consortium	BIPV ARRAY NOMINAL POWER	18 kW
		ANNUAL ELECTRICITY GENERATION PER BIPV MODULE AREA	102 kWh/m <sup>2</sup>
		ANNUAL ELECTRICITY GENERATION	18.7 MWh






## Arrival Centre in Schönbrunn



PROJECT DESCRIPTION		PROJECT CHARACTERISTICS	
LOCATION	Vienna, Austria (48° 11' 10" N)	ANNUAL HORIZONTAL SOLAR IRRADIATION	1.3 MWh/m <sup>2</sup>
USE	Carport	KÖPPEN CLIMATE CLASSIFICATION	Continental subarctic - Dfc
PV PRODUCER	Erte Solar	BIPV APPLICATION	Solar shading
ARCHITECT	FCP Fritsch, Chiari & Partner ZT GmbH	TYPE OF CONSTRUCTION	New
ENGINEER	HESS Stahlbau & Montage GmbH	PV TECHNOLOGY	Coloured opaque multi-Si
INSTALLER	Erte Solar	BIPV ARRAY NOMINAL POWER	18 kW
		ANNUAL ELECTRICITY GENERATION PER BIPV MODULE AREA	102 kWh/m <sup>2</sup>
		ANNUAL ELECTRICITY GENERATION	18.7 MWh

# A Decision-Making Process for BIPV Design

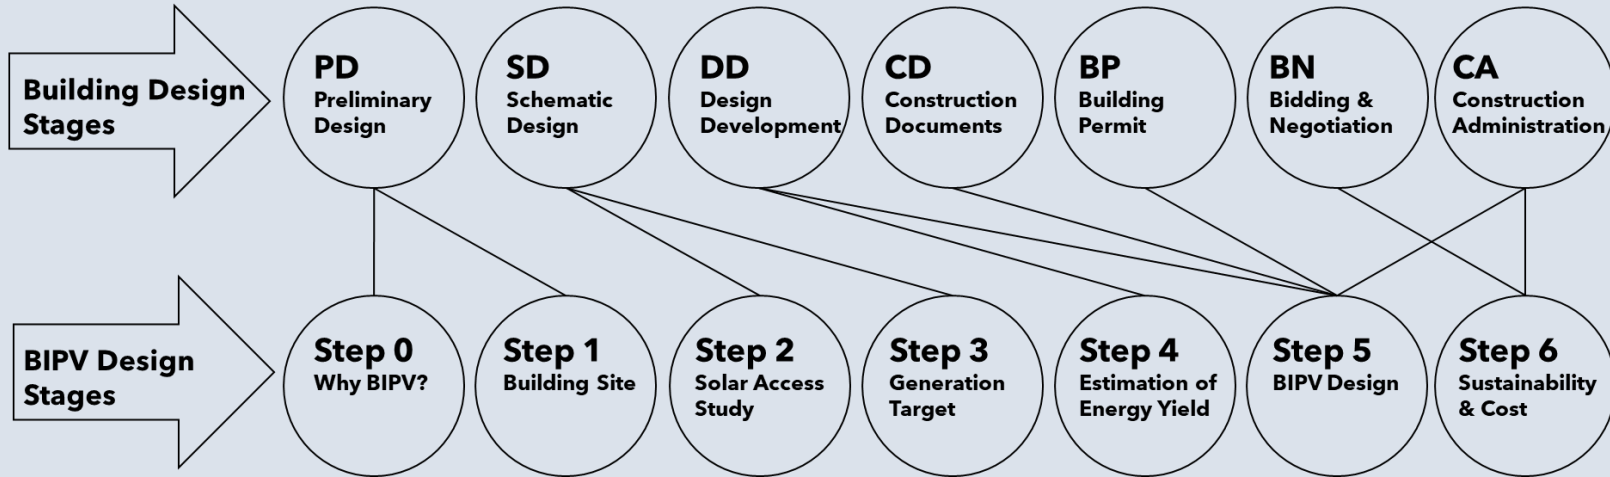

# A Decision-Making Process for BIPV Design

---



## **STEP 0 - WHY BIPV?**


- Energy Generation & Savings
- Regulatory Compliance
- Enhanced Aesthetics
- Increased Property Value
- Corporate Green Status (if applicable)
- Renewable Energy Credits & Incentives (if applicable)

# A Decision-Making Process for BIPV Design




## STEP 1 - ASSESS BUILDING SITE

- Orientation & Tilt Angle
- Utility Requirements
- Zoning Bylaws
- Is it a Heritage Designation?

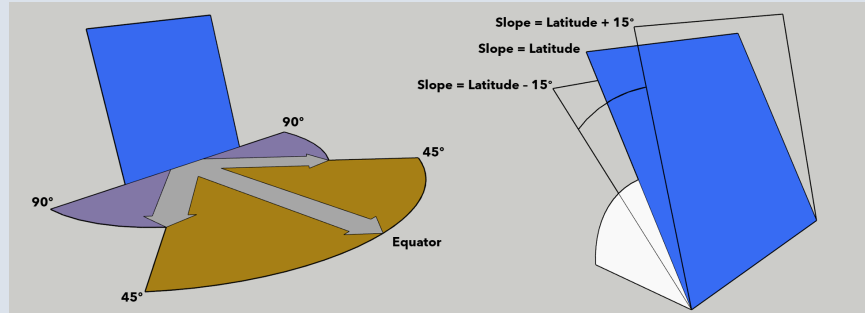

## STEP 2 - PERFORM A SOLAR ACCESS STUDY


- Solar Availability
- Solar Access Simulation Study

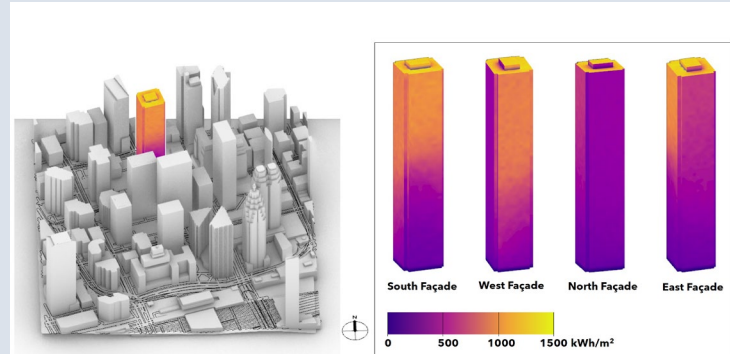



## STEP 3 - DETERMINE ANNUAL BIPV ENERGY GENERATION TARGET

- Partial Energy Offset Target
- Self-Consumption Target
- Net-Zero Energy Target
- Carbon Neutral Target

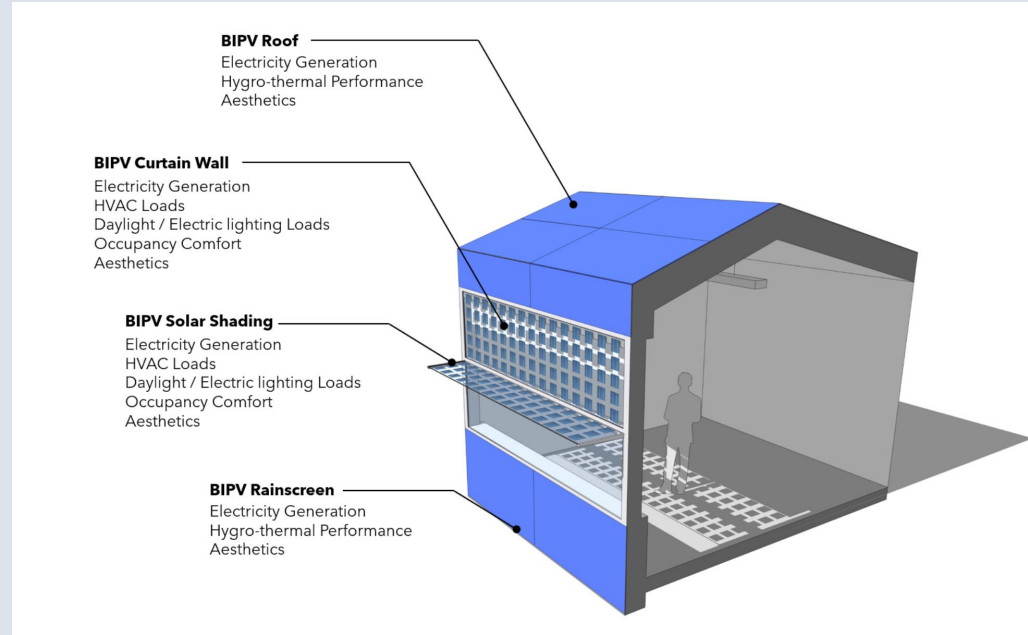

# A Decision-Making Process for BIPV Design

---



## **STEP 4 - ESTIMATE BIPV INSTALLED CAPACITY AND ENERGY YIELD**

- Shading
- Soiling, Snow & Ice

## **STEP 5 - DEVELOP THE BIPV DESIGN**

- Modules
- Mounting System
- Strings and Arrays
- Balance of System
- Inverters
- Apply for Utility Interconnection



## **STEP 6 - ASSESS SUSTAINABILITY, CIRCULARITY AND LIFE CYCLE COST**

- Modules
- Non-Renewable Energy Payback Time
- Environmental Footprint
- Circularity
- Life Cycle Cost Analysis

## **STEP 7 - BUSINESS MODELS**

- Feed-in Tariff
- Net-Metering
- Power Purchase Agreement
- BIPV-as-a-Service



**Questions?  
Feel free to reach out**

Costa Kapsis, [costa.kapsis@uwaterloo.com](mailto:costa.kapsis@uwaterloo.com)